

WARNING LABEL EMBEDDED INTO CONCRETE COVER READS AS FOLLOWS:

CAUTION:
DO NOT ENTER WITHOUT PROPER VENTILATION.
COULD CAUSE DEATH...DANGEROUS GAS.

29" DIAMETER CONCRETE COVER WITH 4" DIA. CAST IRON OR SCH. 40 PIPE. **
(WHEN SCH. 40 PIPE IS USED, IT WILL BE GROOVED OR SCORED TO INSURE ITS BOND WITH THE CONCRETE)

** HEIGHT OF PIPE TO BE FIELD DETERMINED.

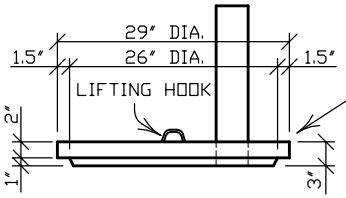

4" PVC PIPE MODIFIED:
SLOT IN SIDE ACTS AS A GAUGE FOR HIGH LEVEL FLOAT.

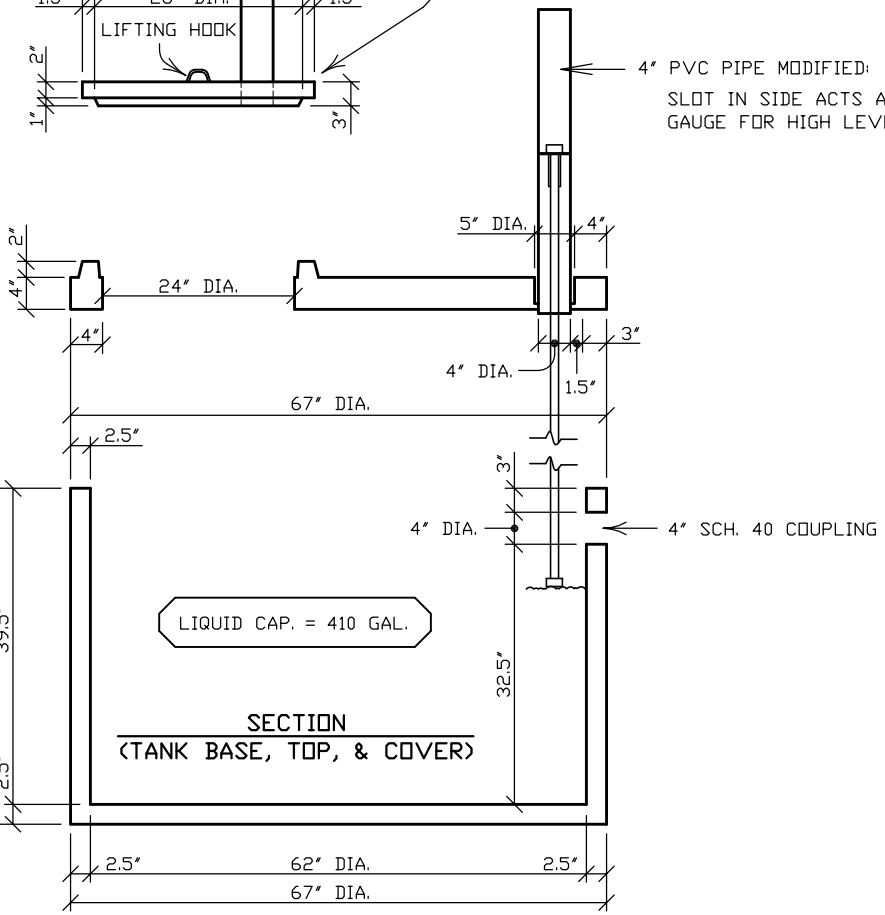

SECTION
(TANK BASE, TOP, & COVER)

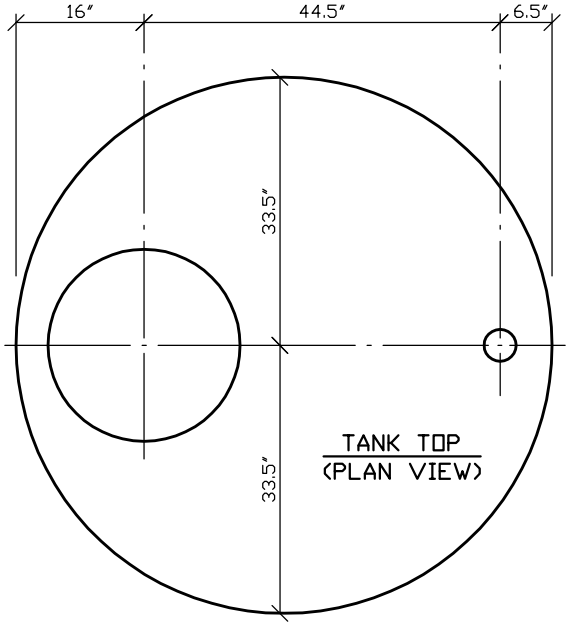

TANK TOP
(PLAN VIEW)

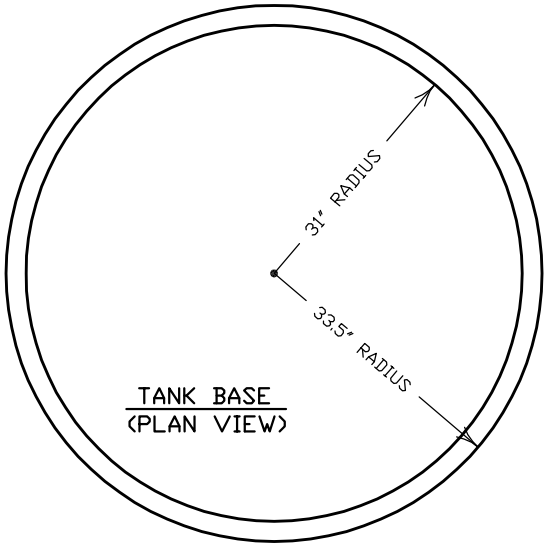

TANK BASE
(PLAN VIEW)

N.P.C.A. CERTIFIED PLANT & MEMBER OF: NATIONAL & WISCONSIN PRECAST CONCRETE ASSOCIATIONS

THIS DRAWING SHALL NOT BE COPIED OR SUBMITTED TO OTHERS WITHOUT THE CONSENT OF THIS COMPANY.

HUFFCUTT CONCRETE, INC.
4154 123rd STREET
CHIPPEWA FALLS, WI 54729
(715) 723-7446 * FAX (715) 723-7111 * (800) 924-1516 * www.huffcutt.com

TANK:
375 GALLON
TRANSFER
CONTAINER